

REPLACEMENT KIT

Accessories for fire hydrants

07.501



Products description

- Replacement kit for fire hydrant
- Protection against rupture by “Fusible flange”
- In case of fire hydrant rupture caused by an occasional impact, a water leakage does not exist
- The sectioning of the hydrant is done by a fuse of the flange (fire hydrant separate items)
- The repair consists in replacement of fusible flange
- This repair is quick and of the low price
- Available in 2 models:
 - A. Replacement fuse kit SOMEPAL and CLASSIC
 - B. Replacement fuse kit IGNIS.



A



B



Fucoli-Somepal
FUNDICÃO DE FERRO, S.A.

Visit our website at www.fucoli-somepal.pt

Head office: Estrada de Coselhas, 3000-125 Coimbra – Portugal | Tel.: (+351) 239 490100 | Fax: (+351) 239 490198

Branch office: Rua de Aveiro 50, 3050-420 Pampilhosa – Portugal | Tel.: (+351) 239 490100 | Fax: (+351) 231 949292 | comercial@fucoli-somepal.pt

Ed.8 Rev. 1
04-2025

Being one of the main objectives of our company the development and satisfaction of our customers, we reserve the right to update, change or replace the specifications presented without prior notice.




REPLACEMENT KIT

Accessories for fire hydrants

07.501



A . Replament fuse kit SOMEPAL and CLASSIC

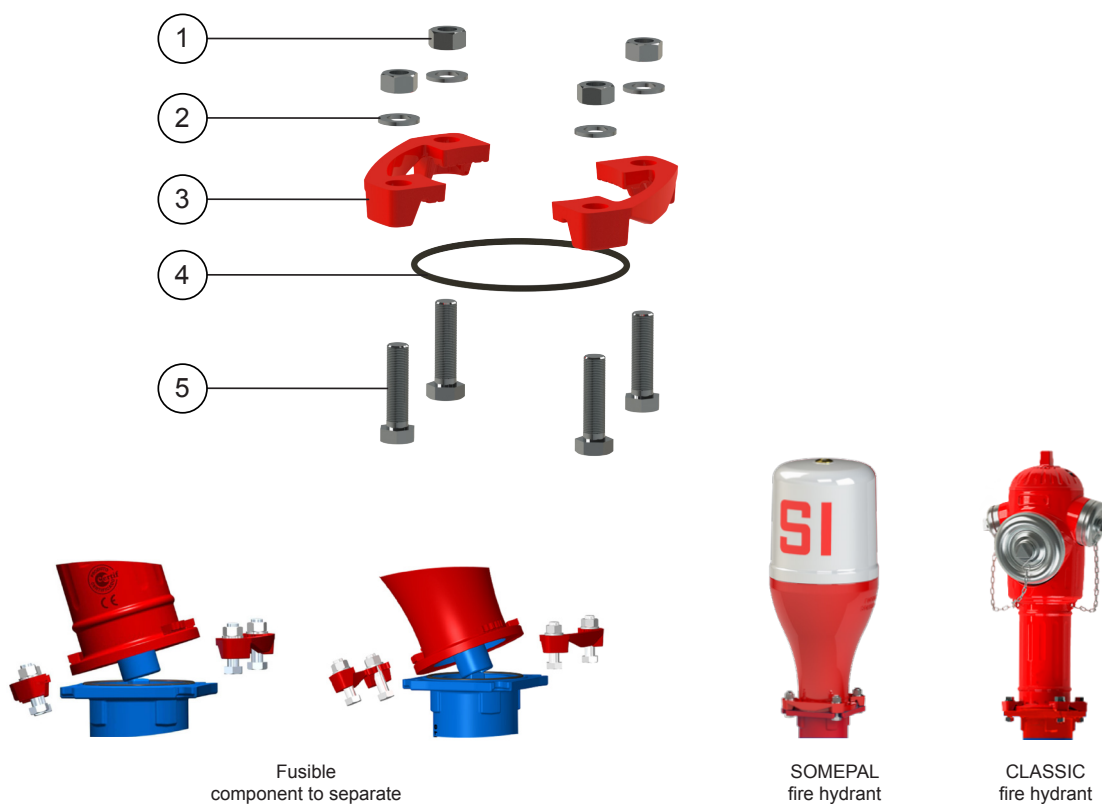

Component list

pos.	components	material	standard
1	Nut (4x)	Stainless steel A4	EN 10088 - 1
2	Washer (4x)	Stainless steel A2	EN 10088 - 1
3	Flange fuse (2x)	Ductile iron EN-GJS-500-7	EN 1563
4	O-ring (1x)	Elastomer EPDM	EN 681 - 1
5	Bolt (4x)	Stainless steel A2	EN 10088 - 1

Reference and dimensions

code	designation	Kg approx.
11212000	Replacement fuse kit (Somepal and Classic)	2

continued on next page

REPLACEMENT KIT



Accessories for fire hydrants

07.501



continued from previous page

B . Replament fuse kit IGNIS

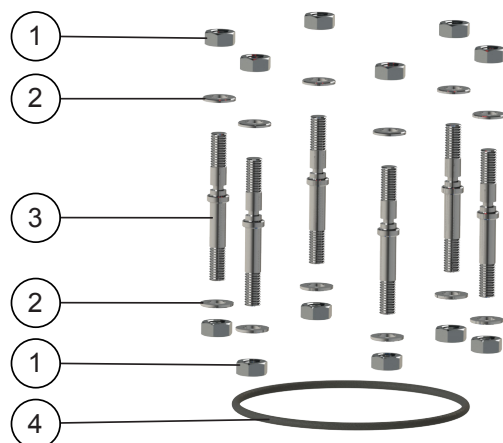

Fusible
component to separate



IGNIS
fire hydrant

Component list

pos.	components	material	standard
1	Nut (12x)	Stainless steel A4	EN 10088 - 1
2	Washer (12x)	Stainless steel A2	EN 10088 - 1
3	Threaded bolt fuse (6x)	Stainless steel A2	EN 10088 - 1
4	O-ring (1x)	Elastomer EPDM	EN 681 - 1

Reference and dimensions

code	designation	Kg approx.
11212015	Replacement fuse kit (Ignis)	2



Fucoli-Somepal
FUNDIÇÃO DE FERRO, S.A.

Visit our website at www.fucoli-somepal.pt

Head office: Estrada de Coselhas, 3000-125 Coimbra – Portugal | Tel.: (+351) 239 490100 | Fax: (+351) 239 490198

Branch office: Rua de Aveiro 50, 3050-420 Pampilhosa – Portugal | Tel.: (+351) 239 490100 | Fax: (+351) 231 949292 | comercial@fucoli-somepal.pt



All drawings, technical data, dimensions and weights are not binding. Subject to change. The components may be replaced by equivalent or higher materials without prior notice.

Ed.8 Rev. 1