

## KEY

### Accessories for fire hydrants

07.500



#### Products description

- Key to open fire hydrant
- Available in 2 models:
  - A. Universal maneuver key, allows the firemen corporations operating all the SOMEPAL, CLASSIC and IGNIS fire hydrants
  - B. Key for inviolable blank caps.



**Fucoli-Somepal**  
FUNDICÃO DE FERRO, S.A.

Visit our website at [www.fucoli-somepal.pt](http://www.fucoli-somepal.pt)

**Head office:** Estrada de Coselhas, 3000-125 Coimbra – Portugal | Tel.: (+351) 239 490100 | Fax: (+351) 239 490198

**Branch office:** Rua de Aveiro 50, 3050-420 Pampilhosa – Portugal | Tel.: (+351) 239 490100 | Fax: (+351) 231 949292 | [comercial@fucoli-somepal.pt](mailto:comercial@fucoli-somepal.pt)


# KEY

## Accessories for fire hydrants

07.500



### A . Universal maneuver key for SOMEPAL and CLASSIC fire hydrants

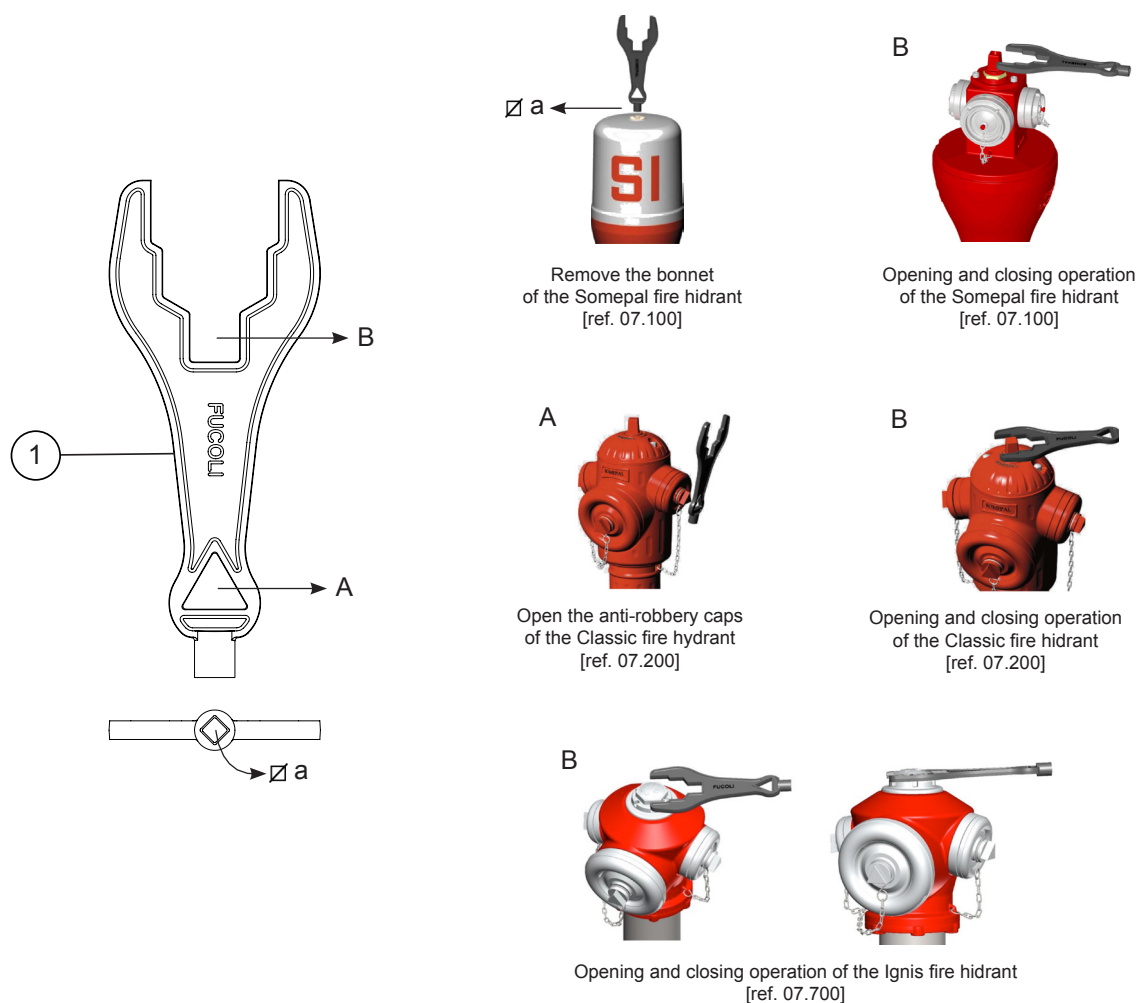

## Component list

pos.	components	material	standard
1	Key	Ductile iron EN-GJS-500-7	EN 1563

## Reference and dimensions

code	designation	Ø a mm	Kg approx.
11212000	Replacement fuse kit (Somepal and Classic)	14	2

continued on next page


## KEY Accessories for fire hydrants

07.500



continued from previous page

### B . Key for inviolable blank caps

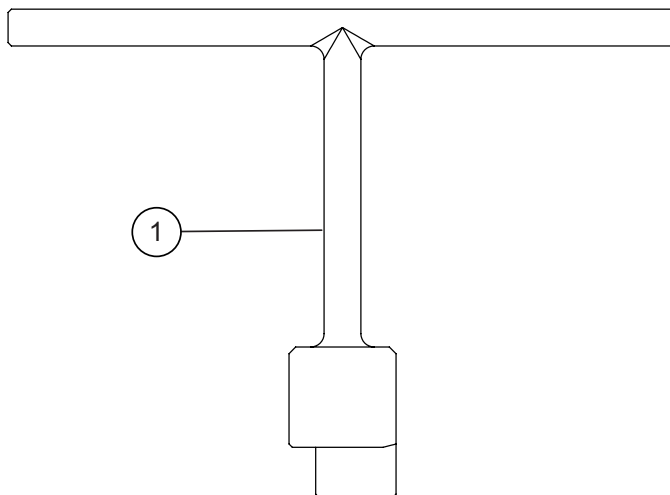

Inviolable blank caps  
of the Classic fire hydrant  
[ref. 07.200]

### Component list

pos.	components	material	standard
1	Key	Stainless steel	EN 10088 - 1

### Reference and dimensions

code	designation	Kg approx.
11209065	Key for inviolable blank caps	1



**Fucoli-Somepal**  
FUNDIÇÃO DE FERRO, S.A.

Visit our website at [www.fucoli-somepal.pt](http://www.fucoli-somepal.pt)

**Head office:** Estrada de Coselhas, 3000-125 Coimbra – Portugal | Tel.: (+351) 239 490100 | Fax: (+351) 239 490198

**Branch office:** Rua de Aveiro 50, 3050-420 Pampilhosa – Portugal | Tel.: (+351) 239 490100 | Fax: (+351) 231 949292 | [comercial@fucoli-somepal.pt](mailto:comercial@fucoli-somepal.pt)



100% MADE IN EUROPE

All the drawing, technical data, dimensions and weights are not binding. Subject to change. The components may be replaced by equivalent or higher materials without prior notice.

Ed.8 Rev. 2 3/3